


Full lift safety valve with spring loading.(AIT)

Model 486



ASME
SI Units

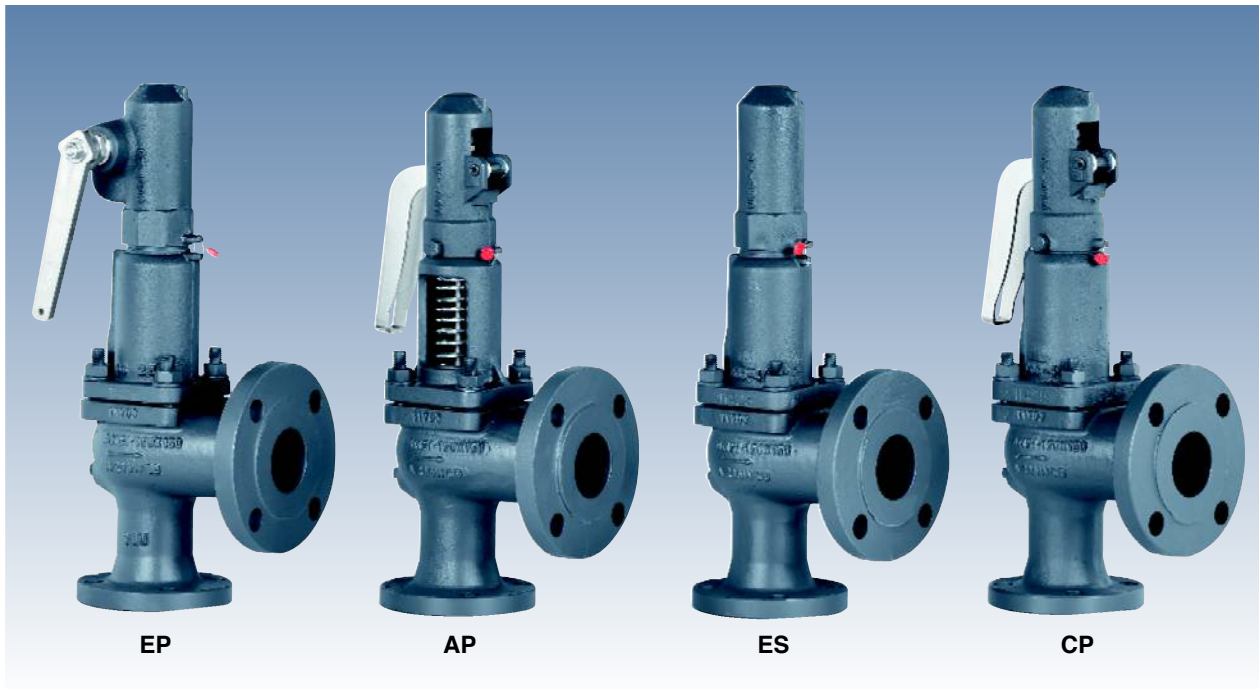

The valve works as an automatic pressure releasing regulator activated by the static pressure existing at the entrance to the valve and is characterized by its ability to open instantly and totally.

Design in accordance with "ASME code section VIII".

Materials according ASME code section II and ASTM. Connections according ASME/ANSI B16.5-2009 standard. Center to face dimensions according API-526.

In accordance with the requirements of directive 97/23/EC.

EC valve verification certified by: TÜV Internacional Grupo TÜV Rheinland, S.L. EC 0035.

Type (Module D) EC examination report n° 33530455 certified by: TÜV Internacional Grupo TÜV Rheinland, S.L.

In compliance with the ATEX 94/9/CE directive "Protective equipment and systems for use in potentially explosive atmospheres".

Other authorisations: ISCIR, ITI, NASTHOL,...etc.

Specifications

- 90° angular flow.
- Activated by direct action helicoid spring.
- Simplicity of construction ensuring minimum maintenance.
- Materials carefully selected for their resistance to corrosion. With the exception of washers and couplings, the valves are free of non-ferric materials.
- Internal body designed to offer favourable flow profile.
- Sealing surfaces treated and balanced, making them extremely tightness, even exceeding API-527 requirements.
- Great discharge capacity. For liquids typically used with openings similar to proportional safety valves.
- Equipped with draining screws for removing condensation.
- Auto-centering plug.
- Threaded shaft with lever positioner facilitating immediate manual action.
- Elevator, independent of the seal, designed facilitate sudden opening when the steam expands and, with any fluid, guarantees absolute opening and closing precision.
- All the valves are supplied sealed at the set pressure requested, simulating operational conditions, and are vigorously tested.
- All components are numbered, registered and checked. If requested in advance, material, casting, test and efficiency certificates will be enclosed with the valve, and the instruction manual, in accordance with P.E.D.97/23 EC.

IMPORTANT

Depending on demand:


- 1.- Blocking screw which facilitates hydrostatic testing of the container which to be protected.
- 2.- Rapid limiter to reduce the coefficient of discharge.
- 3.- Fluorelastomer (Vitón) seals, Silicone's rubber, PTFE (Teflón)... etc., achieving leakage levels less than

$$0,3 \times 10^{-3} \frac{\text{Pa cm}^3}{\text{seg.}}$$

The ranges of application allow certain flexibility although we recommend limiting them to:

RANGE OF APPLICATION FOR THE SEALS								
FLUID		SET PRESSURE IN bar						
		0,2	1,8	4,0	4,8	7,0	30,0	40,0
Saturated steam		S	V	T				
Liquids and gases		S			V		T	
SEALS		TEMPERATURE IN °C						
		ACCORDING TO MANUFACTURERS			RECOMMENDED BY VYC			
		MINIMUM	MAXIMUM		MINIMUM	MAXIMUM		
Silicone's rubber	S	-60	+200		-50	+115		
Fluorelastomer (Vitón)	V	-40	+250		-30	+150		
PTFE (Teflón)	T	-265	+260		-80	+230 (1)		


(1) For temperatures exceeding 230°C apply metallic seal only

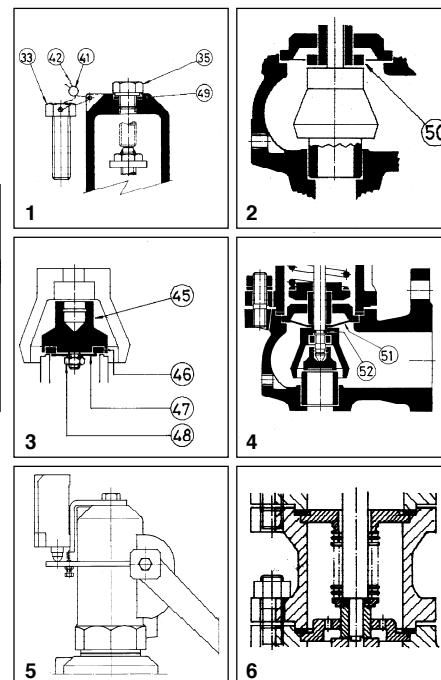


- 4.- Fluorelastomer (Vitón) membrane and O-ring isolating the rotating or sliding parts from the working fluid.
- 5.- Electrical contact indicating open/closed.
- 6.- Balance bellows to:
 - Protect the spring from atmospheric influences.
 - Ensure outside of valve body is totally tightness.
 - Level out external or self-generated back pressure.
- 7.- Possibility of manufacture in other types of material, for special operating conditions (high temperatures, fluids, etc.).
- 8.- Totally free of oil and grease, to work with oxygen, avoiding possible fire risks (UV-Oxygen-VBG 62).
- 9.- Special springs for critical temperatures.

Nº. PIECE	PIECE	MATERIAL											
		CAST STEEL								STAINLESS STEEL			
1	Body	ASTM A216 - WCB								ASTM A351 - CF8M			
2	Closed bell	ASTM A536 65 - 45 - 12								ASTM A351 - CF8M			
3	Open bell	ASTM A216 - WCB								ASTM A351 - CF8M			
4, 5, 6	Hood	ASTM A536 65 - 45 - 12								ASTM A351 - CF8M			
7	Elevator	ASTM A536 65 - 45 - 12 (1)								ASTM A351 - CF8M (7)			
8	Cam	ASTM A570-36 (6)								AISI 304			
9, 10	Lever	ASTM A570 - 36								ASTM A570 - 36			
11	Seating	AISI 420								AISI 630			
12	Plug	AISI 420								AISI 630			
13	Lead	AISI 420 (4)								AISI 316 (5)			
14	Spring press	AISI 1045								AISI 303			
15	Separator	AISI 420								AISI 316			
16	Rod	AISI 420								AISI 316			
17	Lever shaft	AISI 1045								AISI 303			
18	Gudgeon	AISI 1070								AISI 301			
19	Ring	AISI 420								AISI 316			
20, 21	Safety ring	AISI 301								AISI 301			
22	Spring	AISI 6150(2)								AISI 301(3)			
23	Gland	AISI 1045								AISI 303			
24	Hollow screw	AISI 303								AISI 303			
25	Hollow screw nut	AISI 303								AISI 303			
26	Buffer nut	AISI 303								AISI 303			
27	Rod check nut	AISI 1015								AISI 316			
28, 29, 48	Nut	AISI 1015								AISI 316			
30, 31	Washer	AISI 1015								AISI 316			
32	Stud	AISI 1035								AISI 316			
33, 34, 35	Screw	AISI 1045								AISI 316			
36	Cap	AISI 1035								AISI 316			
38	Coupling	Graphite								PTFE (Teflon)			
39	Coupling	PTFE (Teflon)								PTFE (Teflon)			
40	Seal	Graphite								PTFE (Teflon)			
41	Seal	Plastic								Plastic			
42	Sealing wire	Sealing wire								Sealing wire			
43	Characteristic plate	AISI 304								AISI 304			
45	Plug	AISI 316								AISI 316			
46	Sealing disk	PTFE (Teflon)								PTFE (Teflon)			
		Silicone's rubber								Silicone's rubber			
		Fluorelastomer (Viton)								Fluorelastomer (Viton)			
47	Washer	AISI 316								AISI 316			
49	Coupling	Copper								PTFE (Teflon)			
50	Limiter	AISI 420								AISI 316			
51	Membrane	Fluorelastomer (Viton)								Fluorelastomer (Viton)			
52	O-ring	Fluorelastomer (Viton)								Fluorelastomer (Viton)			
NPS ₁ x NPS ₂		1"x2" a 8"x10"											
Class		150 lbs								150 lbs			
OPERATING CONDITIONS	PRESSURE IN bar	16,90	13,80	12,10	12,20	8,40	6,50	5,52	15,64	13,70	10,20	4,60	
	MAX. TEMP. IN °C	120	200	250	300	350	400	426,67	120	200	300	450	
	MIN. TEMP. IN °C	-29								-29			
Class		300 lbs								300 lbs			
OPERATING CONDITIONS	PRESSURE IN bar	46,00	43,80	41,90	39,80	37,60	34,70	28,27	40,72	35,70	31,60	28,80	
	MAX. TEMP. IN °C	120	200	250	300	350	400	426,67	120	200	300	450	
	MIN. TEMP. IN °C	-29								-29			


(1) 1"x2" in stainless steel (ASTM A351 CF8M).
 (2) Spring steel (ASTM A228) for wire spring Ø ≤ 10 mm. Maximum temperature EP, ES and CP 250°C / AP 400°C.
 (3) Vanadium chrome steel (ASTM A16150) for wire spring Ø > 10 mm.
 (4) 8" x 10" in Stainless steel (ASTM A743 CA40F).
 (5) 8" x 10" in Stainless steel (ASTM A351 CF8M).
 (6) 1"x2" in Stainless steel (AISI 304).
 (7) 11/2"x2" to 4"x6" L in Stainless steel (AISI 316)

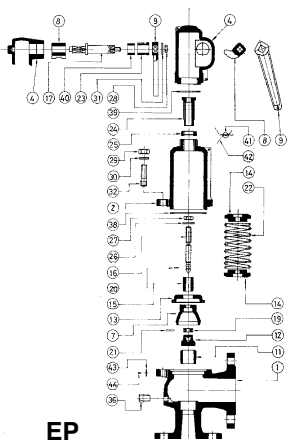


EP

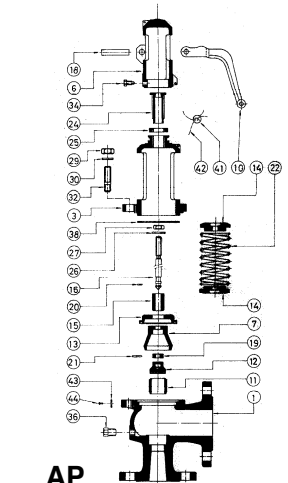

AP

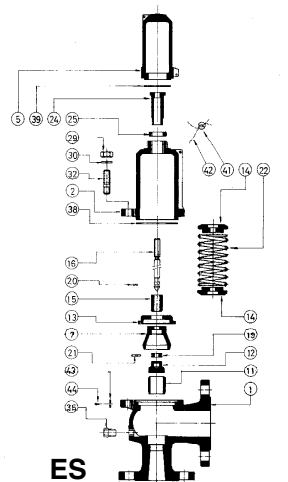

ES

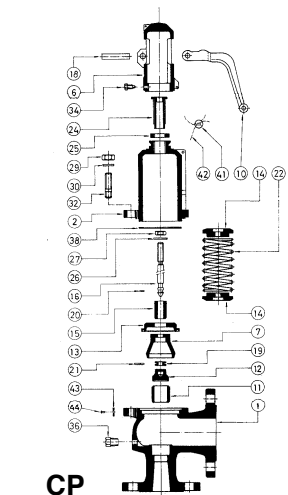

CP

Full lift safety valve with spring loading (AIT) model 486 - AP and CP.

1. Disassembly and assembly.

1.1 Disassembly.

To replace the spring (22) or clean any of the internal components of the valve, proceed in the following manner:

A - Withdraw the clip (18), using a punching tool, until the lever (10) comes free.

B - Loosen the screws (34) and take the cap (6) off.

C - Holding the spindle (16) steady, loosen the hollow screw nut (25) and the hollow screw (24) until you note a releasing of the spring (22).

D - Mark on the spindle (16) the position of the spindle lock-nut (27) and the adjusting nut (26). Loosen them and remove them.

E - Unscrew the nuts (29) and remove them, together with the studs (32) and their washers (30).

F - Lift the cover (3) or (2) and you will have access to all of the components.

1.2 Assembly.

A - Place the safety-ring (20) on the spindle (16) and press it against the gasket (12).

B - In the spindle channel (16) connect the ring (19) and fix it to the security-ring (21). Introduce the elevator (7) into the upper part of the spindle (16) and press this against the previously described pieces.

C - Enter the guide (13), the separator (15), the spring-press (14), the spring (22), the spring-press (14) through the upper part of the spindle (16) and press this against the previously described pieces.

D - Replace the assembly (38) and the cover (3) or (2).

E - Place the washers (30) on the studs (32) and make up the nuts (29) diagonally, checking the correct alignment of the cover (3) or (2).

F - Adjust the firing pressure with the hollow screw (24) and fix the adjustment position with the hollow screw nut (25).

G - Turn the spindle lock-nut (27) and the adjusting nut (26) to the position marked (see 1.1.D) and make up against each other.

H - Introduce the cap (6) and tighten the screws (34).

I - Place the lever (10) and fix it with the fastener (18).

2. Adjusting the firing pressure.

A - Proceed according to points 1.1.A, 1.1.B, 1.1.C.

B - Proceed according to points 1.2.F, 1.2.H, 1.2.I.

Full lift safety valve with spring loading (AIT) model 486 - EP.

1. Disassembly and assembly .

1.1 Disassembly.

To replace the spring (22), or clean any of the internal components of the valve, proceed in the following manner:

A - Move the lever (9) in direction C as far as the constructive catcher.

B - Unscrew the cap (4) and remove.

C - Holding the spindle (16) steady, loosen the hollow screw nut (25) and the hollow screw (24) until you note a releasing of the spring (22).

D - Mark on the spindle (16) the position of the spindle lock-nut (27) and the adjusting nut (26). Loosen them and remove them.

E - Unscrew the nuts (29) and remove them, together with the studs (32) and their washers (30).

F - Lift the cover (2) and you will have access to all of the components.

1.2 Assembly.

A - Place the safety-ring (20) on the spindle (16) and press it against the gasket (12).

B - In the spindle channel (16) connect the ring (19) and fix it to the security-ring (21). Introduce the elevator (7) into the upper part of the spindle (16) and press this against the previously described pieces.

C - Enter the guide (13), the separator (15), the spring-press (14), the spring (22), the spring-press (14) through the upper part of the spindle (16) in a correlative manner.

D - Replace the assembly (38) and the cover (2).

E - Place the washers (30) on the studs (32) and make up the nuts (29) diagonally, checking the correct alignment of the cover (2).

F - Adjust the firing pressure with the hollow screw (24) and fix the adjustment position with the hollow screw nut (25).

G - Turn the spindle lock-nut (27) and the adjusting nut (26) to the position marked (see 1.1.D) and make up against each other.

H - Change the coupling (39) and lightly tighten the cap (4). Move the lever (9) towards position A as far as the constructive catcher. Definitely tighten the cap (4).

2. Adjustig the firing pressure.

A - Proceed according to points 1.1.A, 1.1.B, 1.1.C.

B - Proceed according to points 1.2.F, 1.2.H.

Full lift safety valve with spring loading (AIT) model 486 - ES.

1. Disassembly and assembly.

1.1 Disassembly.

To replace the spring (22), or clean any of the internal components of the valve, proceeded in the following manner:

A - Unscrew the cap (5) and remove.

B - Holding the spindle (16) steady, loosen the hollow screw nut (25) and the hollow screw (24) until you note a releasing of the spring (22).

C - Unscrew the nuts (29) and remove them, together with the studs (32) and their washers (30).

F - Lift the cover (2) and you will have access to all of the components.

1.2 Assembly.

A - Place the safety-ring (20) on the spindle (16) and press it against the gasket (12).

B - In the spindle channel (16) connect the ring (19) and fix it to the security-ring (21).

Introduce the elevator (7) into the upper part of the spindle (16) and press this against the previously described pieces.

C - Enter the guide (13), the separator (15), the spring-press (14), the spring (22), the spring-press (14) through the upper part of the spindle (16) in a correlative manner.

D - Replace the washers (38) and the cover (2).

E - Place the washers (30) on the studs (32) and make up the nuts (29) diagonally, checking the correct alignment of the cover (2).

F - Adjust the firing pressure with the hollow screw (24) and fix the adjustment position with the hollow screw nut (25).

G - Change the coupling (39) and tighten the cap (5).


2. Adjusting the firing pressure.

A - Proceed according to points 1.1.A, 1.1.B.

B - Proceed according to points 1.2.F, 1.2.G.

NPS ₁ x NPS ₂		1" x 2"	1 1/2" x 2"	1 1/2"x2 1/2"	1 1/2"x3"(2"x3")	2"x3"(3"x4")*	3"x4"(4"x6")*	4" x 6"	4" x 6"	6" x 8"	8" x 10"			
API Orifice Letter		D - E	F	G	H	J	L	N	P	Q	T			
do		16	20	25	32	40	50	63	77	110	155			
Ao = $\frac{\pi \cdot do^2}{4}$		201	314	491	804	1257	1964	3117	4657	9503	18870			
H		367	412	436	498	545	665	745	810	1070	1200			
h ¹		112	129	129	148	148	191	191	191	247	331			
L ₁		114	121 (152)*	121 (152)*	124	124 (181)*	165 (181)*	209,5	229 (254)*	241	279			
L ₂		105	124	124	130	136,5 (184)*	155,5 (179)*	197	181 (225)*	240	276			
R		1/4"	1/4"	1/4"	1/4"	1/4"	3/8"	3/8"	3/8"	3/8"	3/8"			
Whitworth gas-tight cylindrical female thread ISO 228/ 1 de 1978 (DIN-259)														
INTAKE FLANGE	Class 150 lbs / ASME ANSI B16.5	D ₁	110	125	125	125	150	190	230	230	280	345		
		K ₁	79,2	98,6	98,6	98,6	120,7	152,4	190,5	190,5	241,3	298,5		
		I ₁	15,9	15,9	15,9	15,9	19,5	24,3	24,3	24,3	25,9	29		
		b ₁	14,7	17,9	17,9	17,9	19,1	19,1	19,1	19,1	22,2	22,2		
		DRILLS N.º	4	4	4	4	4	4	8	8	8	8		
		D ₁	125	155	155	155	165	210	255	255	32	380		
		K ₁	88,9	114,3	114,3	114,3	127	168,3	200	200	269,9	330,2		
		I ₁	17,9	21,1	21,1	21,1	22,7	29	32,2	32,2	37	41,7		
		b ₁	19,1	22,2	22,2	22,2	19,1	22,2	22,2	22,2	22,2	25,4		
		DRILLS N.º	4	4	4	4	8	8	8	8	12	12		
ESCAPE FLANGE	Class 150 lbs / ASME ANSI B16.5	D ₂	150	150	180	190	190	230	280	280	345	405		
		K ₂	120,7	120,7	139,7	152,4	152,4	190,5	241,3	241,3	298,5	362		
		I ₂	19,5	19,5	22,7	24,3	24,3	24,3	25,9	25,9	29	30,6		
		b ₂	19,1	19,1	19,1	19,1	19,1	19,1	22,2	22,2	22,2	25,4		
		DRILLS N.º	4	4	4	4	4	8	8	8	8	12		
CODE	STAINLESS STEEL 2002-486	CAST STEEL 2002-486	MODEL											
			EP	AP	ES	CP	EP	AP	ES	CP	EP	AP	ES	CP
Weight lb/kg	150 lbs	300 lbs	8104D	8104D	8104D	8104D	8104D	8104D	8104D	8104D	8104D	8104D	8104D	8104D
			8104D	8104D	8104D	8104D	8104D	8104D	8104D	8104D	8104D	8104D	8104D	8104D
150 lbs	300 lbs	8102D	8102D	8102D	8102D	8102D	8102D	8102D	8102D	8102D	8102D	8102D	8102D	8102D
		8102D	8102D	8102D	8102D	8102D	8102D	8102D	8102D	8102D	8102D	8102D	8102D	
150 lbs	300 lbs	8102D	8102D	8102D	8102D	8102D	8102D	8102D	8102D	8102D	8102D	8102D	8102D	8102D
		8102D	8102D	8102D	8102D	8102D	8102D	8102D	8102D	8102D	8102D	8102D	8102D	

Center to face dimensions according API-526.
*Dimensions corresponding to 300x150 lbs.

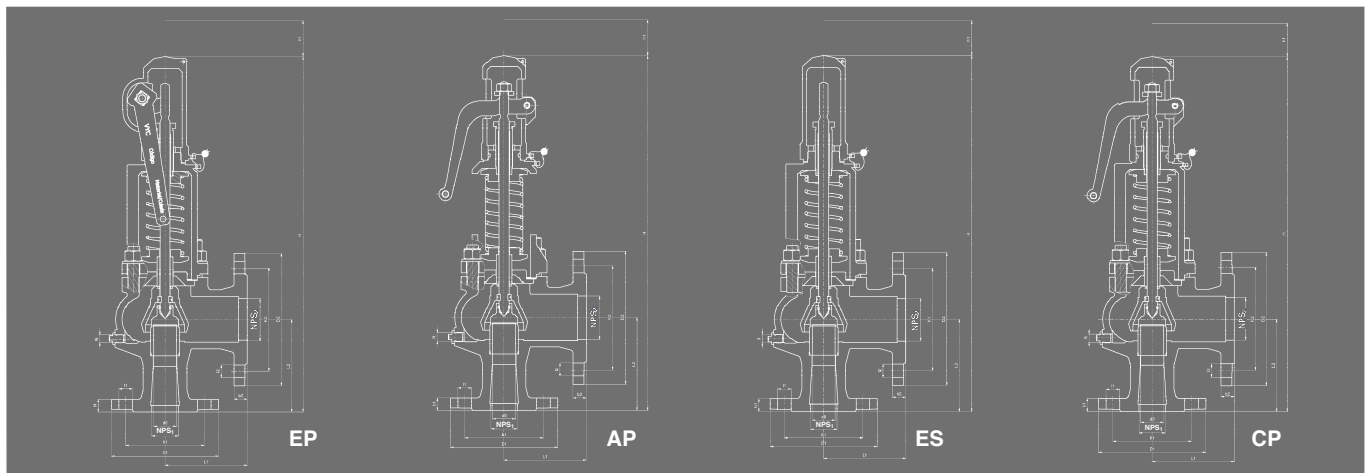

RECOMMENDED RANGES OF APPLICATION						
MODEL			EP	AP ₍₁₎	ES	CP ₍₁₎
FLUID		SATURATED STEAM	*	*		*
		GASES	*		*	
		LIQUIDS	*		*	
PERMISSIBLE BACK PRESSURE IN % OF SET PRESSURE	INTERNAL OR GENERATED	SATURATED STEAM GASES	15			
		LIQUIDS	—			
	EXTERNAL VARIABLE (1)	SATURATED STEAM GASES	5			
		LIQUIDS	—			
	EXTERNAL CONSTANT (1)(2)(3)	SATURATED STEAM GASES	50			
		LIQUIDS	90			
% OVERPRESSURE		SATURATED STEAM GASES	10			
		LIQUIDS	25			

OPEN AND CLOSED PRESSURES IN % OF SET PRESSURE			
FLUID	PRESSURE IN bar	OPENING PRESSURE	CLOSING PRESSURE
SATURATED STEAM GASES	< 3	+ 5 %	- 0,3 bar
	≥ 3	+ 5 %	- 10 %
LIQUIDS	< 3	+ 10 %	- 0,6 bar
	≥ 3	+ 10 %	- 20 %



- (1) If external backpressure exists, the AP and CP model cannot be used.
 - (2) With external constant backpressure, the spring is adjusted deducting the backpressure from the set pressure.
 - (3) If the set pressure < 3 bar we must consider the total atmospheric pressure (1 bar) as external constant backpressure being freely released.
- If $p_a > 0,25p_s$, we must limit plug speed with the consequent reduction of the αd coefficient of discharge.
With the new reduced coefficient we determine the d_0 , in order to remove the necessary volume.
 p_a = Backpressure permitted [bar] absolute.
 p_s = Set pressure [bar] absolute.
 αd = Coefficient of discharge.

SET PRESSURES AND REGULATING RANGES												
NPS ₁ x NPS ₂			1" x 2"	1 1/2" x 2"	1 1/2" x 2 1/2"	1 1/2" x 3" (2" x 3")	2" x 3" (3" x 4")	3" x 4" (4" x 6")	4" x 6"	4" x 6"	6" x 8"	8" x 10"
API Orifice Letter			D-E	F	G	H	J	L	N	P	Q	T
SET PRESSURES IN bar	MAXIMUM (LIQUIDS AND GASES)	150 lbs	19,6	19,6	19,6	19,6	19,6	19,6	19,6	19,6	10	8
		300 lbs	40	40	40	32	32	32	25	20	10	8
	MAXIMUM (SATURATED STEAM)	150 lbs	19,6	19,6	19,6	19,6	19,6	19,6	19,6	19,6	10	8
		300 lbs	40	40	40	32	32	32	25	20	10	8
	MINIMUM	STEAM AND GASES	0,5	0,5	0,5	0,5	0,5	0,5	0,5	0,5	0,5	0,5
		LIQUIDS	0,2	0,2	0,2	0,2	0,2	0,2	0,2	0,2	0,2	0,2
SPRING REGULATING RANGE IN bar	0,20 a 0,68	CODE	56210 56390	56226 56406	56242 56422	56258 56438	56273 56453	56288 56468	56303 56483	56317 56497	56511	56521
	0,66 a 1,00	CODE	56211 56391	56227 56407	56243 56423	56259 56439	56274 56454	56289 56469	56304 56484	56318	56512	56522
	0,95 a 1,40	CODE	56212 56392	56228 56408	56244 56424	56260 56440	56275 56455	56290 56470	56305 56485	56319	56513	56523
	1,30 a 1,90	CODE	56213 56393	56229 56409	56245 56425	56261 56441	56276 56456	56291 56471	56306 56486	56320	56514	56524
	1,80 a 2,60	CODE	56214 56394	56230 56410	56246 56426	56262 56442	56277 56457	56292 56472	56307	56321	56515	56525
	2,50 a 3,60	CODE	56215 56395	56231 56411	56247 56427	56263 56443	56278 56458	56293 56473	56308	56322	56516	56526
	3,50 a 5,00	CODE	56216 56396	56232 56412	56248 56428	56264 56444	56279 56459	56294	56309	56323	56517	56527
	4,80 a 6,30	CODE	56217 56397	56233 56413	56249 56429	56265 56445	56280 56460	56295	56310	56324	56518	56528
	6,00 a 8,00	CODE	56218 56398	56234 56414	56250 56430	56266 56446	56281 56461	56296	56311	56325	56519	56529
	7,50 a 10,00	CODE	56219 56399	56235 56415	56251 56431	56267 56447	56282 56462	56297	56312	56326	56520	
	9,50 a 12,50	CODE	56220 56400	56236 56416	56252 56432	56268 56448	56283	56298	56313	56327		
	12,00 a 16,00	CODE	56221 56401	56237 56417	56253 56433	56269 56449	56284	56299	56314	56328		
	15,00 a 20,00	CODE	56222 56402	56238 56418	56254 56434	56270	56285	56300	56315	56329		
	18,00 a 25,00	CODE	56223 56403	56239 56419	56255 56435	56271	56286	56301	56316			
	23,00 a 32,00	CODE	56224 56404	56240 56420	56256 56436	56272	56287	56302				
	30,00 a 40,00	CODE	56225 56405	56241 56421	56257 56437							

- Spring steel (ASTM A228). Maximum temperature for EP, ES and CP 250°C / AP 400°C.
- Vanadium-chrome steel (AISI 6150).
- Stainless steel (AISI 301).

ASME code only applies to setted safety valves at 1,00 bar or above.

COEFFICIENT OF DISCHARGE										
NPS ₁ x NPS ₂	1"x 2"	1 1/2" x 2"	1 1/2" x 2 1/2"	1 1/2" x 3" (2"x3")	2"x 3" (3"x4")	3"x 4" (4"x6")	4"x 6"	4"x 6"	6"x 8"	8"x10"
API Orifice Letter	D-E	F	G	H	J	L	N	P	Q	T
do	16	20	25	32	40	50	63	77	110	155
h	7,00	9,00	12,00	12,00	18,00	18,00	20,00	29,00	36,80	56,15
h ¹	2,60	3,20	4,00	5,20	6,50	8,00	10,00	12,50	19,80	27,90
h/do	0,44	0,45	0,48	0,38	0,45	0,36	0,32	0,38	0,33	0,36
h ¹ /do ⁽¹⁾	0,16	0,16	0,16	0,16	0,16	0,16	0,16	0,16	0,18	0,18
COEFFICIENT OF DISCHARGE α_d	SATURATED STEAM GASES									
	LIQUIDS									
	LIQUIDS WITH RAPID LIMITER (1)									

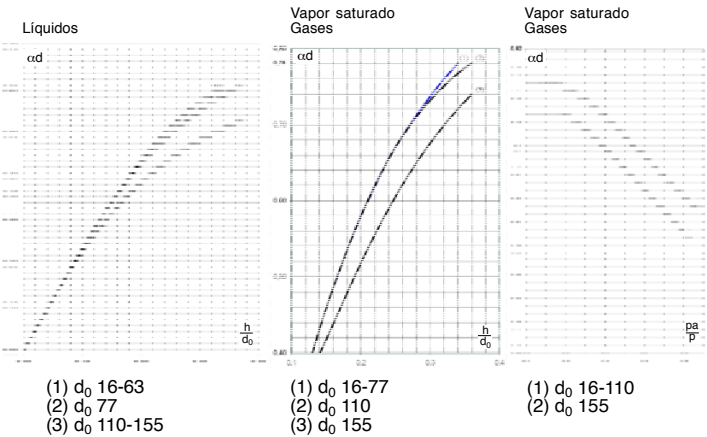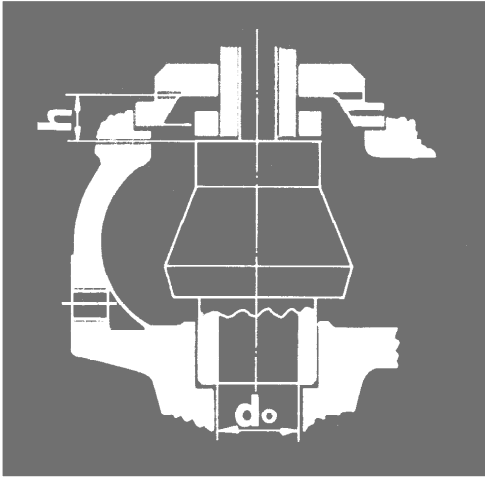

NPS ₁ x NPS ₂	1”x 2”			1 1/2” x 2”			1 1/2” x 2 1/2”		
API Orifice Letter	D-E			F			G		
do	16			20			25		
Ao= $\frac{\pi \cdot do^2}{4}$.	201			314			491		
p [bar] SET PRESSURE IN bar	I - Saturated steam in kg/h. II - Air at 0°C and 1,013 bar in [Nm3/h]. III - Water at 20°C in l/h.								
	I	II	III	I	II	III	I	II	III
1,0	181	242	6721	274	365	10165	442	590	16417
1,5	222	297	7999	336	449	12098	543	724	19540
2,0	263	351	9100	398	532	13763	643	859	22229
2,5	309	412	10174	467	623	15387	754	1006	24853
3,0	354	472	11145	535	714	16856	865	1154	27225
3,5	399	533	12038	604	806	18207	975	1301	29406
4,0	444	593	12869	672	897	19464	1086	1449	31436
4,5	490	654	13650	741	988	20644	1196	1596	33343
5,0	535	714	14388	809	1080	21761	1307	1744	35147
6,0	626	835	15761	946	1263	23838	1528	2039	38502
7,0	716	956	17024	1083	1445	25748	1749	2334	41586
8,0	807	1076	18200	1220	1628	27526	1970	2630	44458
9,0	897	1197	19304	1357	1811	29196	2192	2925	47155
10,0	988	1318	20348	1494	1994	30775	2413	3220	49705
12,0	1169	1560	22290	1768	2359	33712	2855	3810	54449
14,0	1350	1801	24076	2042	2724	36413	3297	4400	58812
16,0	1531	2043	25738	2315	3090	38927	3740	4991	62873
18,0	1712	2285	27299	2589	3455	41289	4182	5581	66687
20,0	1893	2526	28776	2863	3821	43522	4624	6171	70294
22,0	2074	2768	30181	3137	4186	45646	5067	6762	73725
24,0	2255	3010	31523	3411	4552	47676	5509	7352	77003
26,0	2436	3251	32810	3685	4917	49623	5952	7942	80147
28,0	2617	3493	34048	3959	5283	51496	6394	8533	83173
30,0	2799	3735	35243	4233	5648	53303	6836	9123	86092
32,0	2980	3976	36399	4506	6014	55052		9713	88916
34,0		4218	37519		6379	56746		10303	91652
36,0		4460	38607		6745	58391		10894	94309
38,0		4701	39665		7110	59991		11484	96893
40,0		4943	40696		7476	61550		12074	99411

Calculated discharge capacities at set pressure +10% overpressure.

Discharge capacities at 2 bar and below are calculated at set pressure + 0,2 bar of overpressure.

FACT LIST FOR SAFETY VALVE CALCULS Calculus according to ASME code section VIII Div.1				Customer: Theme: Leaf: _____ Of: _____				
1	Consultation / Bid / Order							
2	Position N°							
3	N° of units							
4	Regulation							
5	SERVICE CONDITIONS	Fluid						
6		Calculation temperature °C						
7		State at moment of dischar. l = liquid, s = steam, g = gas		l ☐ s ☐ g ☐	l ☐ s ☐ g ☐	l ☐ s ☐ g ☐		
8		Molecular mass kg/kmol						
9		Adiabatic exponent æ	Compressibility coe. Z					
10		Density at moment of discharge kg/m³						
11		Coefficients ψ max	χ					
12		Viscosity cSt	cPs					
13		Working pressure abs. bar						
14		Set pressure abs. bar						
15		External back pressure abs.						
			constant variable bar					
16		Rated pressure abs. bar						
17	Discharge capacity	Required: kg/h, Nm³/h, l/h						
18		Possible: 1) kg/h, Nm³/h, l/h						
19	VALVE CONSTRUCTION	Opening: Full lift / Normal / Progressive						
20		Manufacturer type						
21		Materials	Body					
22			Seat					
23			Plug					
24			Spring					
25			Joint					
26		Manual discharge action yes / no						
27		Cover Closed / Open						
28		Bellows yes / no						
29		Body with drainage yes / no						
30		Diameter of narrowest flow d _o mm						
31		Section of narrowest flow A _o	Necessary A _o	mm²				
32			Chosen A _o	mm²				
33		Allowed discharge coefficient α _d						
34	CONNECTIONS	Input / Output	NPS	Flange inch				
35				Thread inch NPT				
36				Welding (soldering) ends				
37		Class						
38		Shape of joint surfaces (ASME/ANSI B16.5-2009)						
39	OBSERVATIONS	Unit weight approx. kg						
40								
41								
42								
43	ACCEPTANCE	Certificate according to EN-10204 2.2						
44		Certificate according to EN-10204 3.1						
45								
Date: _____								
Department: _____								
Name: _____								